Description:	Detail No.:	
HIGH WALL WITH BIB FLASHING DETAIL	MPS-HWD2	METAL PANEL SYSTEMS GAUGES ABOVE
	Date: 7/21/26	
Substrate: SUITABLE SUBSTRATE		

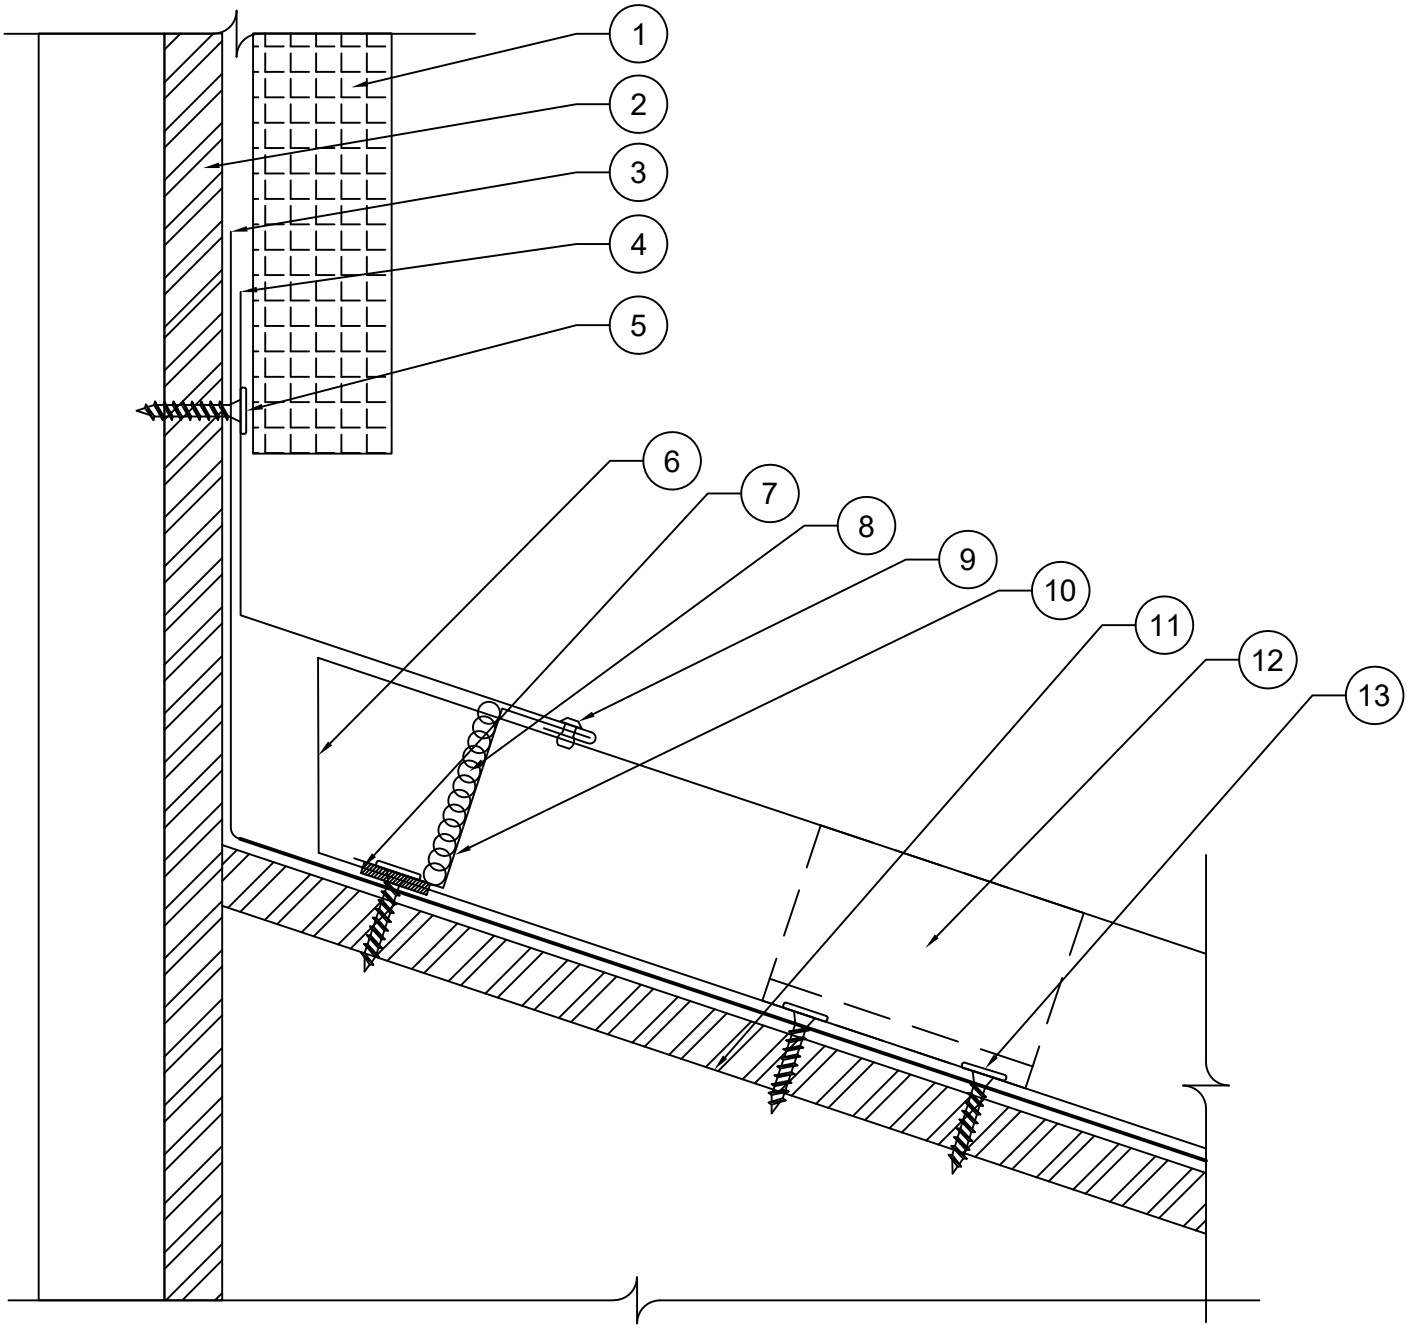

1. EXTERIOR FINISH NOT BY MPS
2. EXTERIOR BUILDING SUBSTRATE NOT NY MPS
3. ONE LAYER OF MPS EPISTIK UNDERLAYMENT ALL OVER THE ROOF AND BEHIND ALL METAL FLASHINGS
4. HIGH WALL FLASHING, 4" END LAP WITH A CONTINUOUS BEAD OF MPS APPROVED SEALANT IN THE LAP, POP RIVETED TO Z-CLOSURES EVERY 30" O.C.
5. MPS APPROVED FASTENERS(#10 X 1-$\frac{1}{8}$" ULP PANCAKE HEAD WOOD SCREW)
6. BREAD PAN AT THE END OF THE PANEL WITHOUT CUTTING CORNERS
7. MPS APPROVED BUYTL TAPE CONTINUOUS
8. CONTINUOUS OF MPS APPROVED SEALANT UP THE VERTICAL LEG OF Z-CLOSURES
9. $\frac{1}{8}$" STAINLESS STEEL POP RIVET TO MATCH TRIM
10. Z-CLOSURES FIELD CUT SET INTO BUYTL TAPE AND FASTENED 4" O.C. INSTALL MPS APPROVED SEALANT ON THE VERTICAL LEGS OF Z-CLOSURE SEALING TO PANEL LEGS
11. SUITABLE DECKING NOT BY MPS
12. MPS PANEL CLIP AND APPROVED FASTENERS INSTALL CLIP WITHIN LAST 1' OF PANEL
13. MPS APPROVED FASTENER(#10 X 1-$\frac{1}{8}$" ULP PANCAKE HEAD WOOD SCREW IS SHOWN)